


EX-ISB-□-□-□-□-□-□-□-□-□-□-□-□

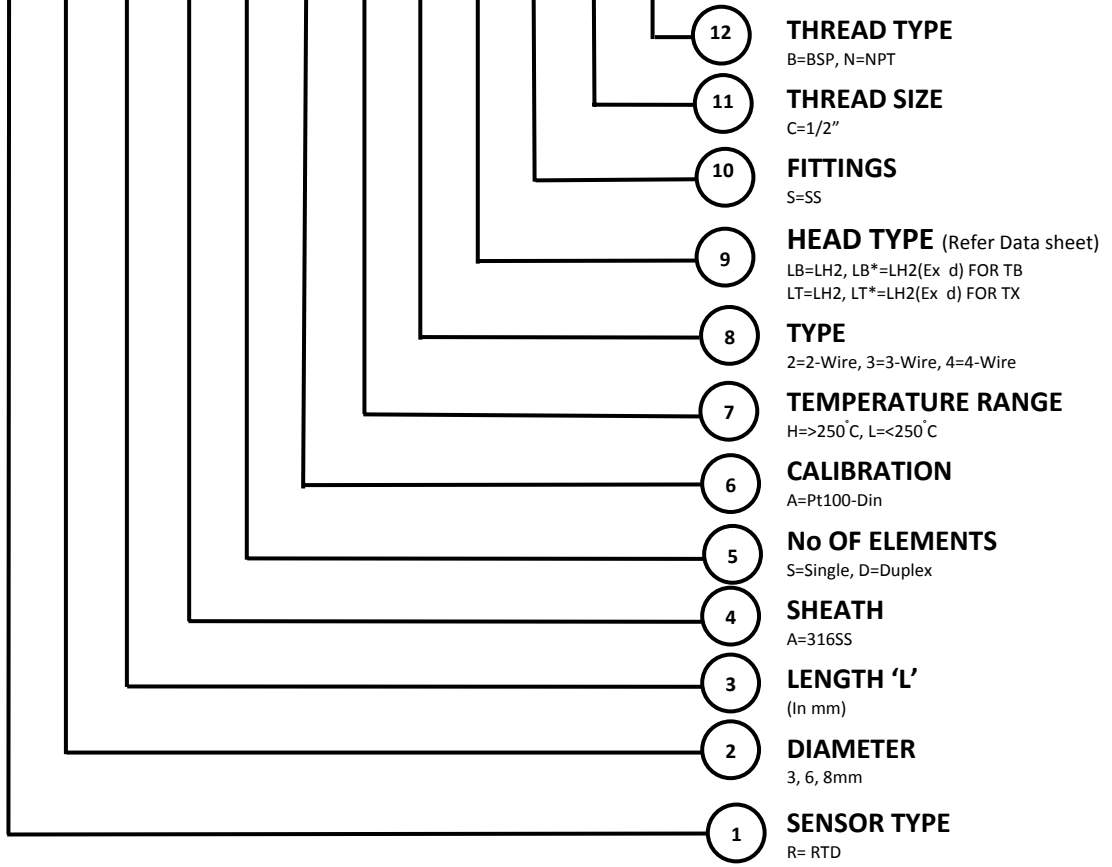

Note 1: If RTD is to be used with a thermowell, please nominate
Type: __ 'U' Length: _____, 'T' Length: _____ (Refer Thermowell data sheets)

SELECTION

EXD-ISB - R - - - A - - A - - - - S - -

1 2 3 4 5 6 7 8 9 10 11 12

Special Requirements: _____ **Note: ISB/ISE are interchangeable**