


Refer to Pyrosales' Special Operating Procedure, COP-SP-110 for manufacturing details

EXD-ISM- - - - - - - - - - -

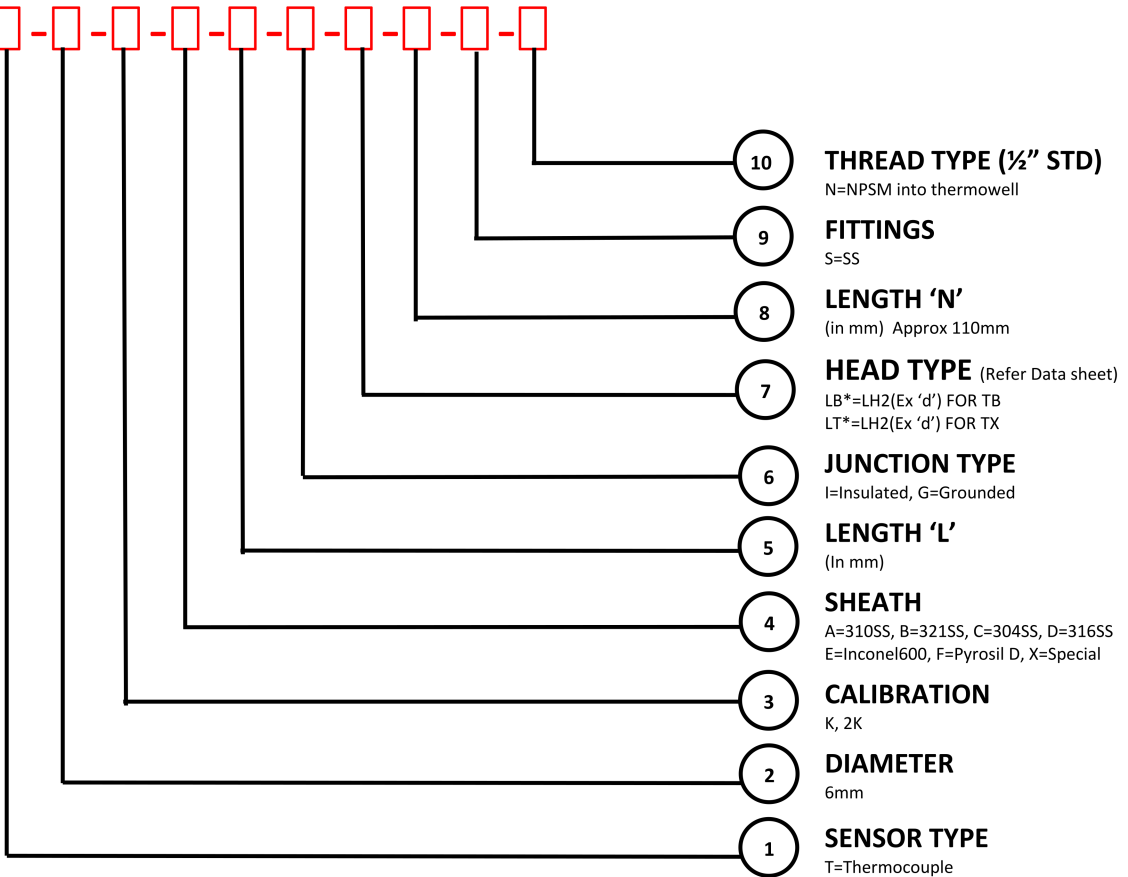

- 10** **THREAD TYPE (½" STD)**
N=NPSM into thermowell
- 9** **FITTINGS**
S=SS
- 8** **LENGTH 'N'**
(in mm) Approx 110mm
- 7** **HEAD TYPE** (Refer Data sheet)
LB*=LH2(Ex 'd') FOR TB
LT*=LH2(Ex 'd') FOR TX
- 6** **JUNCTION TYPE**
I=Insulated, G=Grounded
- 5** **LENGTH 'L'**
(In mm)
- 4** **SHEATH**
A=310SS, B=321SS, C=304SS, D=316SS
E=Inconel600, F=Pyrosil D, X=Special
- 3** **CALIBRATION**
K, 2K
- 2** **DIAMETER**
6mm
- 1** **SENSOR TYPE**
T=Thermocouple

Note 1: If Thermocouple is to be used with a thermowell, please nominate
Type: __, **'U' Length:** _____, **'T' Length:** _____ (Refer Thermowell data sheets)

SELECTION

EXD-ISM-T - 6 - - A - - - - 110 - S - N

1 2 3 4 5 6 7 8 9 10

Special Requirements: _____

Data Sheet ISM-TC

www.pyrosales.com.au

Pyrosales NSW
 Unit 2, 41 Whyalla Place
 PRESTONS NSW 2170
 Tel: (02) 9790 1988
 Fax: (02) 9790 1040
 Email: sales@pyrosales.com.au

Pyrosales Victoria
 Factory 4 Enterprise Way
 BAYSWATER VIC 3153
 Tel: (03) 9729 2100
 Fax: (03) 9720 5559
 Email: vic-sales@pyrosales.com.au

Pyrosales Queensland
 Unit 1, Lot 3, 70 Flanders St
 SALISBURY QLD 4107
 Tel: (07) 3277 9400
 Fax: (07) 3277 9495
 Email: qld-sales@pyrosales.com.au